



ISO Registered Company



Model 764T

MODEL 764T TEMPERATURE CONTROLLER

The Model 764T is a pneumatic temperature controller. It measures the temperature of the fluid with a bimetallic bulb and develops a 3-15 psig (0.2-1.0 Barg) output signal that varies linearly with any change in temperature. The 764T controls temperatures between -70° and +580°F (-60° and +305°C) using six control ranges.

FEATURES

- Adjustments:** Proportional band and setpoint.
- Field Reversible:** Easily changed from direct acting to reverse acting.
- Two Bulb Materials:** 316SST or brass thermal bulbs.
- Gauge:** 1-1/2" (38 mm) output signal gauge.

APPLICATIONS

Designed to control temperature in bleachers, cookers, dryers, evaporators, heaters, heat exchangers, kilns, mangles, molding machines, presses, retorts, sterilizers, stills, vats, washers, etcetera.

SPECIFICATIONS

Control Ranges:

Temperature Ranges	
°F	°C
-70 to +100	-60 to +35
50 to 220	10 to 105
180 to 350	80 to 175

See Option 764T-63 for higher temperature ranges.

Thermal Bulb Materials:

Brass - ASTM B16 and B135 w/Invar Rod
316 SST - ASTM A479 w/Invar rod.

Thermal Bulb Connection:

1/2" NPT.

Maximum Operating Pressure:

3000 psig (207 Barg) at 350°F (177°C) for brass and SST thermal bulbs.

Maximum Emergency Temperature:

450°F (232°C) with standard construction.
850°F (454°C) with Option 764T-63.

Control Housing Sub-Assembly:

Brass housing, Buna-N O-ring seals, SST adjusting screws, etc.

Output Range:

3-15 psig (0.2-1.0 Barg).

Supply Pressure:

18-20 psig (1.2 -1.4 Barg).

Output Signal Gauge:

0-30 psig (0-2.1 Barg) range.

Ambient Temperature Range:

-20° to +180°F (-28° to +82°C).

Proportional Band:

Adjustable between 6° and 32°F (3 and 18°C) with 18-20 psig (1.2-1.4 Barg).

Sensitivity:

Better than 0.2°F (.1°C).

Repeatability:

±0.8°F (±.45°C).

Steady State Air Consumption:

Flow Rate*		Prop. Band	
SCFH	(M ³ /Hr. @ Msc)	°F	(°C)
4.2	(0.12)	6	(3)
50	(1.41)	32	(18)

*Mid-span at proper supply.

Air Connections:

1/4" NPT female pipe connections.

Typical Installations:

See Figures 3, 4, and 5.

OPTIONS

Option-63:

HIGHTEMPERATUREEXTENSION. 316SST thermal bulb for temperatures above 350°F (175°C). See Figure 1.

Temperature Ranges	
°F	°C
380 to 540	190 to 280
400 to 560	205 to 295
430 to 580	220 to 305

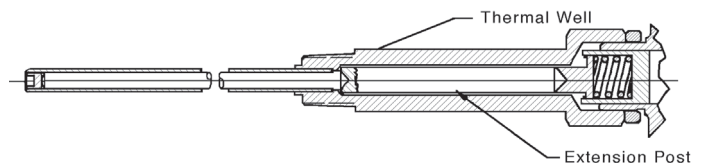


Figure 1

High Temperature Thermal Bulb (Opt. 63).

Option-64:

THERMALWELL. Brass or 316SST thermal well for use with 316SST thermal bulbs, both standard and high temperature (Option 764T-63). 3/4" NPT connection to process piping. Maximum static pressure 1000 psig (68 Barg) at 400°F (204°C) for brass and 6200 psig (427.6 Barg) at 580°F (305°C) for 316SST thermal well.

ACCESSORIES

Volume Booster:

1:1 ratio for improving the stroking speed of diaphragm motor valves when no positioner is used. Incorporates a stabilizing bypass needle valve between input and output (Moore Products - Model 61H).

Air Filter Regulator:

Model 5200P. 1/4" NPT male connections with 1-1/2" (38 mm) supply pressure gauge.

PRINCIPLE OF OPERATION

The 764T controller employs laminar flow to develop the 3-15 psig (2.07-1.03 Barg) output signal. Laminar flow eliminates the need for range springs, levers, pivots and other parts that produce friction and lost motion.

A bimetallic thermal bulb is used to measure temperature. It is immersed in the fluid whose temperature variation changes the length of the outer tube more than it changes the length of the Invar rod. This difference produces a minute movement of the end of the Invar rod that contacts the sensor plate. The sensor plate, in turn throttles the flow of instrument air through the sensor to develop the 3-15 psig (2.07-1.03 Barg) output signal.

On direct acting controllers, see Figure 2, the supply enters PORT B. With an increase in the sensed temperature the supply air flowing through the sensor orifice increases,

which elevates the output signal. The proportional band restriction regulates the flow of exhaust through PORT A.

On reverse acting controllers the supply enters PORT A and passes through the proportional band restriction. With an increase in the sensed temperature the flow through the sensor orifice is increased, which reduces the output signal. PORT B is the exhaust port.

Closing the proportional band adjusting screw reduces the proportional band. Opening the screw increases the proportional band.

The setpoint adjustment moves the sensor closer to, or further away from, the sensor plate to change the controlled temperature. Rotate adjusting screw clockwise to increase temperature set point, counter-clockwise to decrease set point.

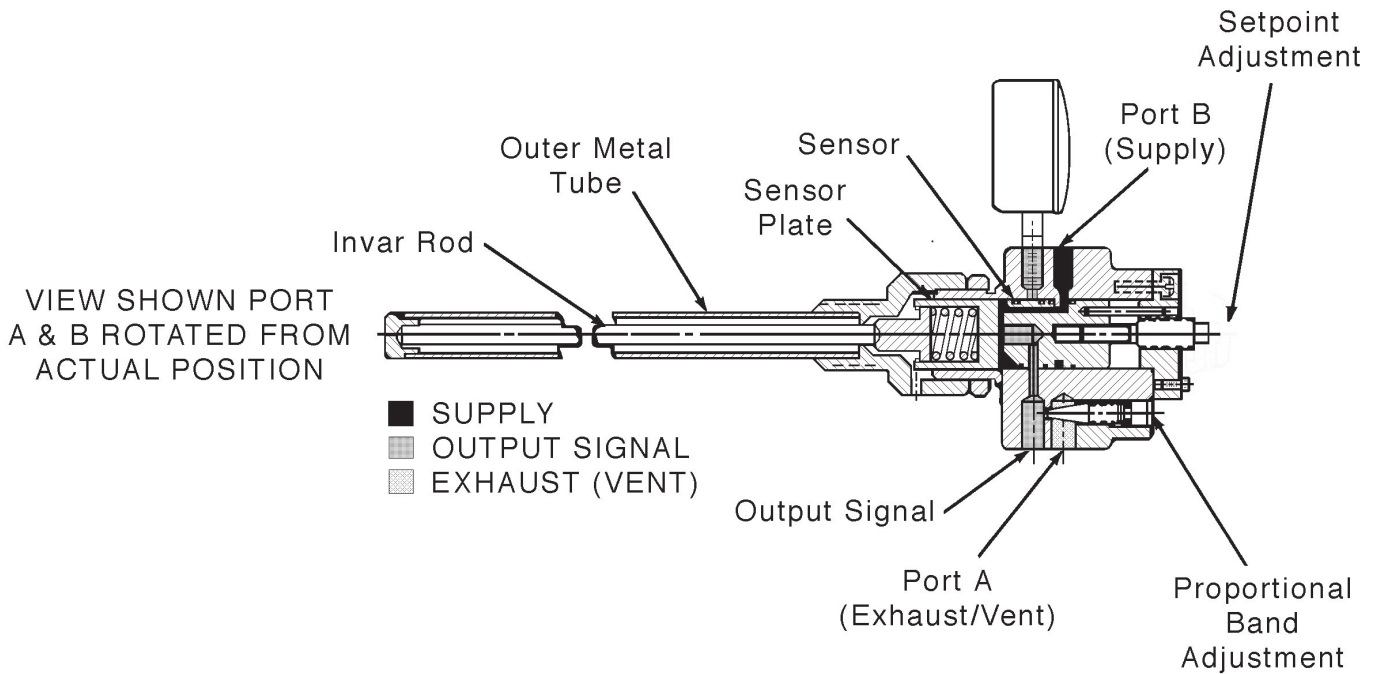


Figure 2
Direct Action 764T


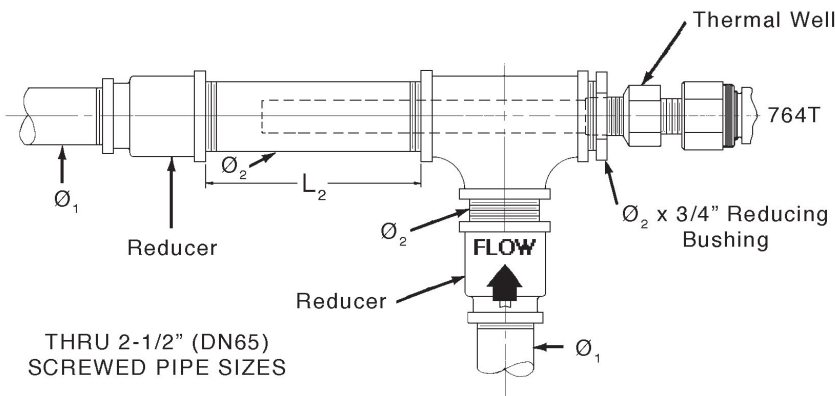


Figure 3


\varnothing_1		\varnothing_2		Nipple Length L_2	
Inch	(DN)	Inch	(DN)	Inch	(mm)
1/2"	(15)	1"	(25)	6"	(152)
3/4"	(20)	1-1/4"	(32)		
1"	(25)	1-1/4"	(32)		
1-1/4"	(32)	1-1/2"	(40)		
1-1/2"	(40)	2"	(50)	NR	NR
2"	(50)	2"	(50)		
2-1/2"	(65)	2-1/2"	(65)		
NR = Not Required.					

FOR INSERTION INTO PIPE PERPENDICULAR TO CENTER LINE OF PIPE, PIPE SIZE MUST BE 8" (DN 200) OR LARGER, WITH OR WITHOUT A THERMAL WELL.

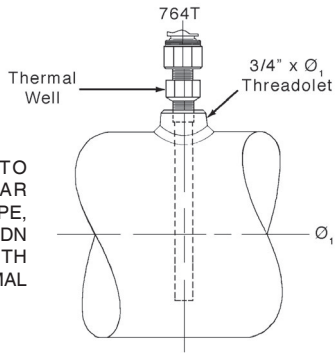



PIPE 8" (DN 200) Ø & LARGER

Figure 4

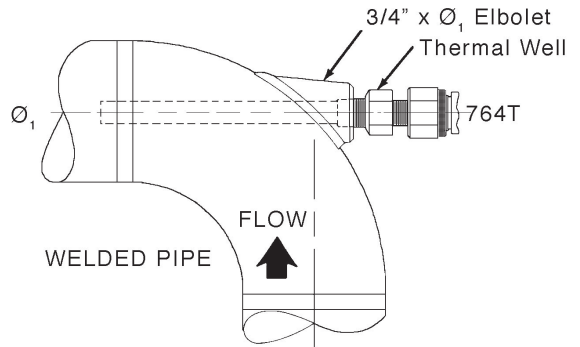

REQ'D: 2-1/2" (DN 65) THRU 6" (DN 150)
OPTIONAL: 8" (DN 200) OR LARGER

Figure 5

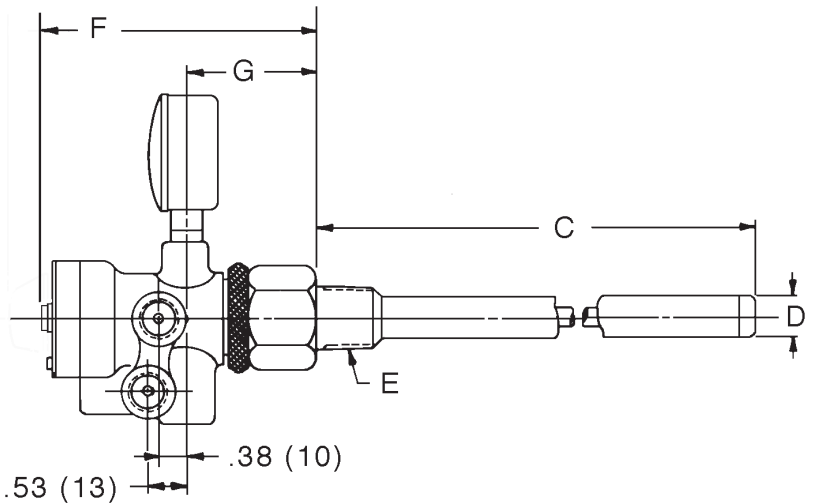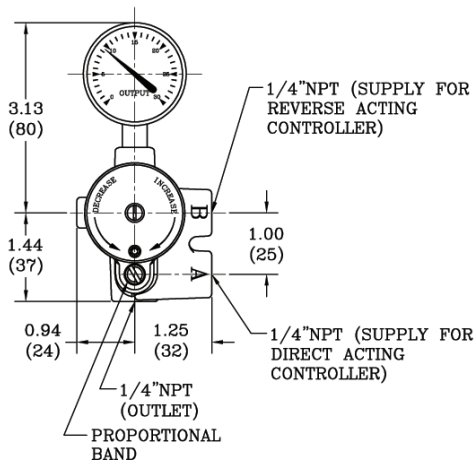

Dimension	Brass Thermal Bulb		SST Thermal Bulb		764T-63 High Temp. Thermal Bulb		764T-63+64 High Temp. & Thermal Well		764T-64 Thermal Well	
	Inches	(mm)	Inches	(mm)	Inches	(mm)	Inches	(mm)	Inches	(mm)
C	7.75	(196)	8.88	(226)	8.88	(226)	8.50	(216)	8.50	(216)
D	0.56	(14)	0.37	(9)	0.37	(9)	0.77	(20)	0.77	(20)
E	1/2 NPT Male		1/2 NPT Male		1/2 NPT Male		3/4 NPT Male		3/4 NPT Male	
F (MAX)	4.13	(105)	4.13	(105)	7.63	(194)	8.75	(222)	5.25	(133)
G	1.81	(46)	1.81	(46)	5.31	(135)	6.44	(164)	2.94	(75)

The contents of this publication are presented for informational purposes only, and while every effort has been made to ensure their accuracy, they are not to be construed as warranties or guarantees, express or implied, regarding the products or services described herein or their use or applicability. We reserve the right to modify or improve the designs or specifications of such product at any time without notice.

Cashco, Inc. does not assume responsibility for the selection, use or maintenance of any product. Responsibility for proper selection, use and maintenance of any Cashco, Inc. product remains solely with the purchaser.

PRODUCT CODER 02/07/20

An "X" in POS 12 followed by a 5-digit control number overrides remaining selections.

CB **1** — **POS 5** **POS 6 & 7** **7** — **0** **POS 11** **POS 12** **0000000A**

POSITION 5 - TEMPERATURE RANGE			
Std. Temp Range - BR or SST Bulb	CODE	High Temp Range - SST Bulb (-63 Opt)	CODE
-70° to +100F	1	380° to 540°F	4
50° to 220°F	2	400° to 560°F	5
180° to 350°F	3	430° to 580°F	6
10° to 105°C	A	190° to 280°C	E
-60° to +35°C	B	205° to 295°C	F
80° to 175°C	C	220° to 305°C	G

POSITION 6 & 7 - MATERIALS				
Applicable Temp Ranges (°F)	Thermal Bulb Material	Thermal Well (-64 Opt)		
		None	Brass	316 SST
		CODE	CODE	CODE
Standard (-70° to +350°)	Brass	B0	--	--
	316 SST	S0	SB	SW
Hi-Temp (-63 Opt) (380° to 580°)	Brass	--	--	--
	316 SST	H0	--	HW

POSITION 11 - ACCESSORIES	
Unmounted Airset (Shipped Loose)	
Description	CODE
No Airset	0
5200P Airset (Filter Regulator) 0-30 psig range (w/gauge)	A

POSITION 12 - OPTIONS	
Construction	CODE
Standard Construction	0
For Special Construction Contact Cashco for Special Code	X

*** For information on ATEX see pages 14 & 15 on the IOM.**

Cashco, Inc.
P.O. Box 6
Ellsworth, KS 67439-0006
PH (785) 472-4461
Fax. # (785) 472-3539
www.cashco.com
email: sales@cashco.com
Printed in U.S.A. 764T-TB

Cashco GmbH
Handwerkerstrasse 15
15366 Hoppegarten, Germany
PH +49 3342 30968 0
Fax. No. +49 3342 30968 29
www.cashco.com
email: germany@cashco.com

Cashco do Brasil, Ltda.
Al.Venus, 340
Indaiatuba - Sao Paulo, Brazil
PH +55 11 99677 7177
Fax. No.
www.cashco.com
email: brazil@cashco.com